



# ACCESSIBILITY CHECKLIST FOR MEDICAL CLINICS AND FACILITIES IN IDAHO

2010 ADA STANDARDS FOR  
ACCESSIBLE DESIGN

NOVEMBER 2015

## Northwest ADA Center

University of Washington  
6912 220th St S.W., Suite 105  
Mountlake Terrace, WA 98043  
Toll Free: (800) 949-4232  
TTY/TDD/TT: (800) 949-4232  
Videophone: (425) 233-8913  
Relay: 7-1-1

Email Address: [nwadactr@uw.edu](mailto:nwadactr@uw.edu)  
Web Address: [www.nwadacenter.org](http://www.nwadacenter.org)

Northwest  Center



Large  
Print

CC



# ACCESSIBILITY CHECKLIST

## TABLE OF CONTENTS

---

<b>SECTION</b>	<b>PAGE</b>
<b>Purpose and Use of the Checklist</b>	i
<b>How to Perform an Accessibility Survey</b>	ii
<b>Accessible Parking</b>	
<i>Number of accessible spaces</i>	1
<i>Access aisles and van accessible spaces</i>	
<i>Curb ramps</i>	
<b>Accessible Approach and Entrance</b>	4
<i>Surfaces and walkways</i>	
<i>Ramps</i>	
<i>Door width</i>	
<i>Door handles and thresholds</i>	
<i>Protruding objects</i>	
<b>Access to Goods and Services</b>	10
<i>Doors</i>	
<i>Aisle width, reach and turning space</i>	
<i>Table placement and height</i>	
<i>Ramps</i>	
<i>Elevators</i>	
<i>Water Fountains</i>	
<i>ATMs</i>	
<b>Toilet Rooms</b>	18
<i>Entrance, turning space, mirrors and sinks</i>	
<i>Pipes, floor space, faucets and dispensers</i>	
<i>Toilets and grab bars</i>	
<i>Stalls and single-user restrooms</i>	
<b>Waiting Rooms and Registration Counters</b>	23
<b>Accessible Examination Rooms and Medical Equipment</b>	24
<b>Patient Sleeping Rooms</b>	27
<b>Signage - General Requirements</b>	31
<b>Notes and Sketch Page</b>	A
<b>Building and Contact Information</b>	B

---

# ACCESSIBILITY CHECKLIST

## PURPOSE AND USE

The Northwest ADA Center is pleased to provide this Accessibility Checklist. This Checklist is designed to be a convenient tool for identifying architectural and communication barriers that may be encountered by people with disabilities in public and private buildings. The Checklist may also assist you in planning for removal of barriers to accessibility. The Checklist may be used to survey an entire facility or specific areas and elements. More definitive information may be obtained from the 2010 Standards for Accessible Design. In some situations, the 1991 Standards for Accessible Design and your state or local building code may provide helpful information. The Accessibility Checklist can also be used as a guide to increase awareness of architectural and communication barriers which prevent full access to buildings and facilities by people with disabilities. ***This checklist is NOT a substitute for federal accessibility standards or the appropriate state and local building codes.***

The Checklist is designed so that a

“**YES**” answer indicates “**ACCESSIBLE**”.

“**NO**” answer indicates that the item is present but is a “**NON-ACCESSIBLE**” element or feature in the building or facility.

**Dimensions** provided in this Checklist are given in units of inches (IN) or feet (FT).

### References

2010 ADA Standards for Accessible Design ([www.ada.gov](http://www.ada.gov))

1991 ADA Standards for Accessible Design ([www.ada.gov](http://www.ada.gov))

**Safe Harbor** - If the elements or features of your facility are in compliance with the 1991 ADA Standards for Accessible Design you do not have to modify those elements to comply with the 2010 Standards (even if the new standards have different requirements for them). This provision is applied on an element-by-element basis and is referred to as the "**safe harbor**." If you choose to alter elements that were in compliance with the 1991 Standards, the safe harbor no longer applies to those elements and you must use the 2010 Standards. The 2010 Standards contain new requirements for elements in existing facilities that were not addressed in the original 1991 Standards. These include recreation facilities such as swimming pools, play areas, exercise machines, miniature golf facilities, and bowling alleys. Because these elements were not included in the 1991 Standards, they are not subject to the safe harbor. Therefore, on or after March 15, 2012, public accommodations (businesses) must remove architectural barriers to elements subject to the new requirements in the 2010 Standards when it is readily achievable to do so. State and local government entities must remove barriers to achieve program accessibility.

**Alternate Formats** - This Checklist will be provided in alternate formats upon request.

*Developed with support of a grant from the National Institute on Disability, Independent Living, and Rehabilitation Research (NIDILRR).*

*Revised November 2015 by Northwest ADA Center.*


*We encourage duplication and use of this document.*

# HOW TO PERFORM AN ACCESSIBILITY SURVEY

## Planning for the Survey:

If possible, we suggest that a team of two or more individuals carry out the survey. It is very helpful if one person directs the process, takes pictures and notes while the other person performs the measurements. It is also suggested that people with disabilities be involved in the survey.

**Using a Floor Plan:** It is often helpful to have a floor plan, or a sketch of a floor plan, for note taking while conducting the survey. Elements in this checklist can be identified on the floor plan.

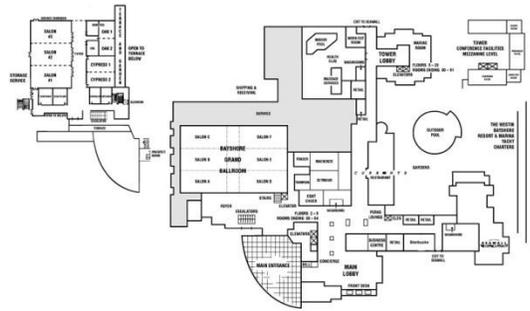


## Tools

- Clipboard to make recording on the checklist easier.
- Flexible steel tape measure.
- Carpenter's level (either electronic or manual) for measuring slope on ramps and inclined walkways.
- Digital fish scale or door pressure gauge for measuring door opening force.
- Digital camera for photo documentation of barriers and accessible features.




## Conducting the Survey:


**Measuring clear width (unobstructed opening)** - To measure the clear width (unobstructed open space) at a door, measure the distance between the face of the door and the door stop, with the door open at 90 degrees. Clear width measurements at other locations (ramps, accessible routes, etc.) are measured in the same manner; measure the width of the unobstructed space for passage.

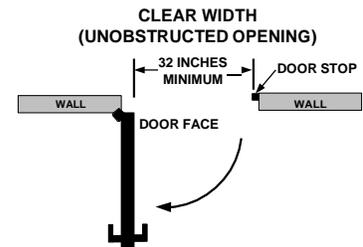

**Measuring slope** - Slope is calculated by calculating the ratio of vertical rise to horizontal run. For example, if a ramp 6 inches in vertical height traverses a horizontal distance of 6 feet (72 inches) then the slope is  $6 / 72 = 1 / 12 = 0.083$  (8.3%). Typically the maximum allowable slope for a ramp is written as 1:12. To measure the slope, lay one end of a carpenter's level on the uphill side of the ramp, lift the downhill end of the tool to bring it to level (bubble in the middle), and measure the distance between the downhill bottom edge of the level and the ramp surface. See the figure. In this case the slope is 3 inches rise over 36 inches horizontal distance or the ratio of 1:12.

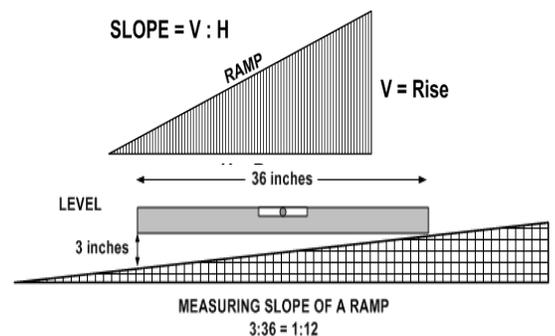

**Measuring door opening force** - If using a fish scale or similar device, tie one end of the scale to the door handle and observe the maximum force displayed on the scale as you pull the door from a closed position.

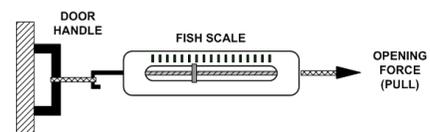

# ACCESSIBLE PARKING

**People with disabilities should be able to arrive at your business and easily locate & use accessible parking.**


## 1. Facility Parking

Does your facility provide accessible parking spaces designated for use by individuals with disabilities?

**Note:** This does not apply to on-street parking spaces.

**Note:** Idaho Code require one (1) parking space will be designated for every thirty-five (35) spaces of on-street parking.

- Yes
- No

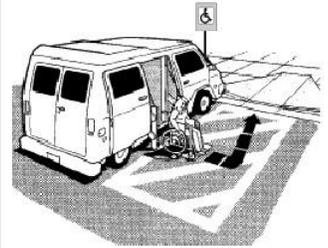

## 2. Number of Accessible Parking Spaces

Does the parking area have the minimum number of accessible parking spaces specified in the table below?

Total Parking Spaces	Designated Accessible Parking
1 to 25	1
26 to 50	2
51 to 75	3
76 to 100	4
101 to 150	5
151 to 200	6
201 to 300	7
301 to 400	8
401 to 500	9
501 to 1000	2% of total
1001 and over	20 plus 1 for each 100 over 1000

**Note:** At least one of every 6 accessible parking spaces must be designated "van accessible." For example, if the facility has only one accessible parking space, then that space must be van accessible. If you have 7 accessible parking spaces then 2 must be van accessible. See Item 5 on the next page.

- Yes
- No



\* If no, how many accessible parking spaces are available?  
\_\_\_\_\_

\* What is the total number of parking spaces available for the public?  
\_\_\_\_\_

## 3. Space Location


Are the accessible parking spaces located on the shortest possible accessible routes to the accessible building entrances?

**Note:** An accessible route is free of stairs, steep inclines, sharp changes in surface level, and has a surface which is stable, smooth and slip resistant. Where parking serves more than one accessible entrance, accessible parking spaces shall be dispersed and located on the shortest accessible route to the accessible entrances.

Are the accessible parking spaces located on a level area?

**Note:** Ground surfaces of parking spaces and access aisles should not exceed 1:48 (approximately 2% slope) in any direction.

- Yes
- No

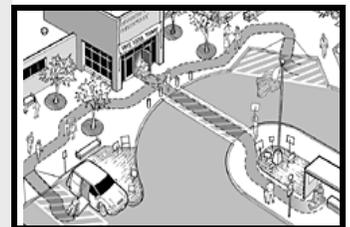

- Yes
- No

# ACCESSIBLE PARKING

## 4. Signs and Dimensions - Accessible Parking Spaces

Is each accessible parking space identified with a sign showing the International Symbol of Accessibility (see figure)?

- Yes
- No



Does each vehicle space in accessible parking have a pavement marking stencil (International Symbol of Accessibility) as shown in the figure?

- Yes
- No

Pavement Marking Stencil



Is each sign mounted on a post at a minimum height of 5 feet (60 inches) measured from the bottom of the sign to the ground surface?

- Yes
- No


**Note:** For signs mounted on buildings or piers, a minimum of 5 feet between bottom of sign and ground surface is required.

Are the vehicle spaces in accessible parking a minimum of 8 feet (96 inches) wide?

- Yes
- No

Does each accessible parking space have a marked access aisle? **Note:** Two accessible parking spaces may share a common access aisle.

- Yes
- No

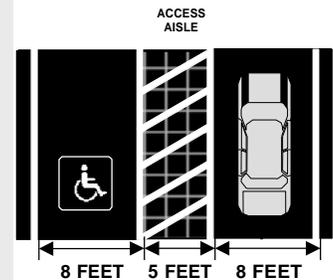

Is each access aisle at least 5 feet (60 inches) wide?

- Yes
- No

## 5. Van Accessible Parking Spaces

Is there at least one van accessible space for every six accessible parking spaces?

- Yes
- No

Is the van accessible parking space designated by an additional sign indicating "Van Accessible" (see figure at right)?

- Yes
- No




Does the van accessible parking space have a vehicle space width of at least 11 feet (132 inches) and an accompanying marked access aisle of at least 5 feet (60 inches)?

- Yes
- No


Do van accessible parking spaces, and the route serving them, have adequate minimum vertical clearance of at least 98 inches?

- Yes
- No

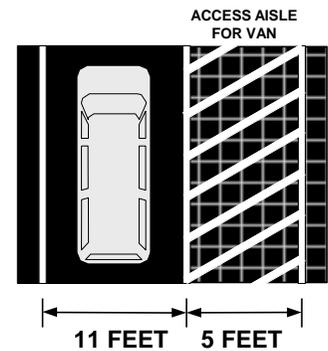

**Note:** Idaho Code require one (1) parking space will be designated for every thirty-five (35) spaces of on-street parking. Van accessible parking space on-street is not a requirement under Idaho Code.

- Yes
- No




# ACCESSIBLE PARKING

## 6. Passenger Loading Zone

If your facility has a passenger loading zone, does it have an unobstructed access aisle at least 5 feet wide and is it as long as the vehicle pull-up space?

- Yes
- No

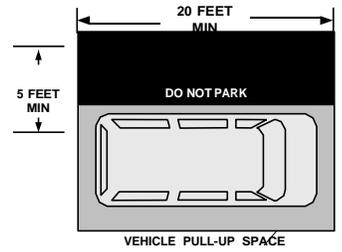

**Note:** The vehicle pull-up space must be a minimum of 8 feet wide and 20 feet long.

Is the access aisle at the same level as the vehicle pull-up space?

- Yes
- No

Is the access aisle marked to discourage parking in that space?

- Yes
- No


## 7. Curb Ramps

Are curb ramps provided where accessible routes cross over a curb (for example, where an access aisle connects to a sidewalk)?

**Note:** Curb ramps must not project into traffic lanes, parking spaces or access aisles.

Do curb ramps have a maximum running slope of 1:12?

- Yes
- No

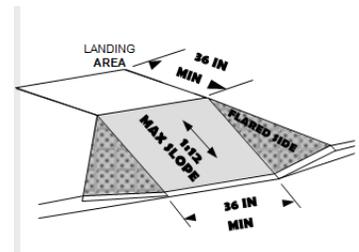

Do curb ramps have a minimum clear width of 36 inches?

- Yes
- No

Are the transition areas where curb ramps join sidewalks, streets or gutters smooth?

- Yes
- No

Are there level landings at the top of the curb ramps which have a minimum length of 36 inches and the same width as the curb ramp?

- Yes
- No

**Note:** Where it is not possible to provide a level landing at the top of a curb ramp, a curb ramp with flared sides that do not exceed a slope of 1:12 is an alternative.

## 8. Accessible Parking at Medical Facilities

A. For hospital outpatient facilities (not doctor's offices or independent clinics), are 10% of the total parking spaces reserved for persons with disabilities?

and outpatient physical therapy facilities), are 20% of the total parking spaces reserved for persons with disabilities?

B. For facilities specializing in treatment of persons with mobility impairments (for example, rehabilitation facilities

## ACCESSIBLE PARKING

Yes

No

Yes

No



# ACCESSIBLE APPROACH AND ENTRANCE (Exterior Routes)

**People with disabilities should be able to arrive at the site, approach the building and enter the building as freely as everyone else. At least one accessible route should be safe and accessible for everyone.**

## 1. Ground and Floor Surfaces

Are ground, floor and walking surfaces along accessible routes stable, firm, smooth and slip-resistant?

**Note:** An “accessible route” may consist of doorways, ramps, curb ramps, elevators, platform lifts and other walking surfaces with a slope no steeper than 5% (1:20).

- Yes
- No



## 2. Changes in Surface Level

Are all ground and floor surfaces along accessible routes free of abrupt changes in surface level? Surface level changes cannot exceed 1/4 inch in height.

Where vertical changes in surface level are between 1/4 and 1/2 inches in height, is the level change beveled (slope 1:2 or less)?


**Note:** Changes in surface level that exceed 1/2 inch shall be ramped.

Are accessible ramps provided for changes in surface level which exceed 1/2 inch in height?

- Yes
- No
- Yes
- No



- Yes
- No

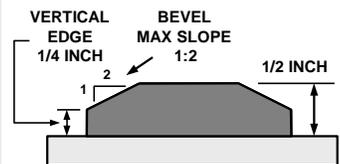

## 3. Clear Widths and Slopes for Walking Surfaces

Is there at least one accessible route from the accessible parking areas, passenger loading zones and other site entry points (bus stops) to the accessible building entrance(s)?

Do all walkways along accessible routes have a minimum clear,

Do longer routes have an occasional 5 x 5 feet area located at reasonable intervals not exceeding 200 feet which can be used for turning and passing?

Do all walkways along accessible routes have cross slopes that are 1:48 or less?

**Note:** When the running slope along the direction of travel on walking surface is greater than 1:20 (5%) the route is considered a “ramp”. See Items 4-8 on the next two pages).


- Yes
- No

- Yes

- Yes
- No

- Yes
- No

MEASURING CLEAR WIDTH OF AN ACCESSIBLE ROUTE IN PRESENCE OF OBSTRUCTIONS WALL




# ACCESSIBLE APPROACH AND ENTRANCE (Exterior Routes)

**IS THERE A RAMP LOCATED ON THE EXTERIOR OF YOUR SITE?**  Yes **IF NO, SKIP TO #9.**  No

## 4. Ramp Slope and Clear Width


Is the maximum running slope of all ramps 1:12 (8.3%)?

- Yes  
 No



Are cross slopes of all ramp surfaces 1:48 or less?

- Yes  
 No



Do ramps have a clear unobstructed width of at least 36 inches?

- Yes  
 No


## 5. Landings

Do ramps have a 5 foot long level landing at the top and bottom of each run?

- Yes  
 No

Do ramps have a 5 foot by 5 foot minimum turning space at level landings where the ramp changes direction?

- Yes  
 No

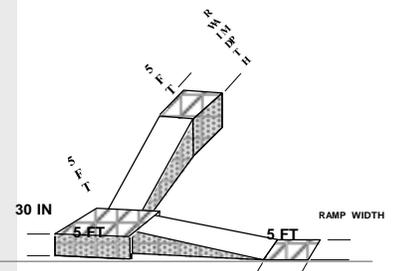


*Note: Landings are required where the maximum vertical rise for any length of run for a ramp is 30 inches.*

## 6. Ramp Handrails

If the ramp rises more than 6 inches vertically, does it have handrails on both sides?


- Yes  
 No

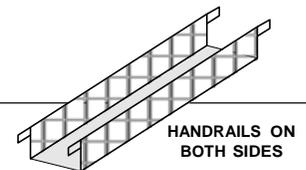

## 7. Handrail Location

Are handrails mounted so that their top surface is between 34 and 38 inches above the ramp surface?

- Yes  
 No

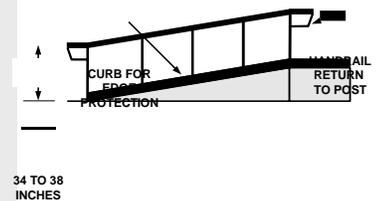


Do handrails continue to extend horizontally at least 12 inches at the top and bottom landings of the ramp and do these extensions return to the wall, floor or post?

- Yes  
 No

If the handrail is mounted on a wall surface, is the gap between the handrail and the wall surface a minimum of 1-1/2 inches?

- Yes  
 No

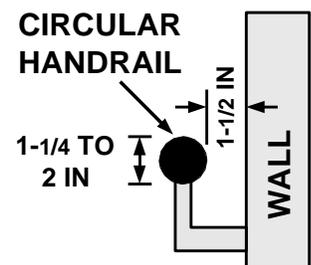

If the handrail gripping surface is circular in shape, is the diameter 1-1/4 inches minimum to 2 inches maximum?

- Yes  
 No

If the shape is non-circular, is the perimeter dimension (distance around the gripping surface) 4 inches minimum to 6-1/4 inches maximum?

- Yes  
 No

# ACCESSIBLE APPROACH AND ENTRANCE (Exterior Routes)

## 8. Edge Protection on Ramps

Do ramps and landings have edge protection?



- Yes
- No

**Note:** Edge protection can be provided by:


1. By extending the floor surface of a ramp or landing at least 12 inches beyond the railing, or,
2. A curb or barrier edge protection that prevents passage of a crutch tip, a wheel on a wheelchair or other mobility aid from slipping off the edge of the ramp or landing.

Examples are:

- a. curbs at least 4 inches high,
- b. horizontal rails placed no more than 4 inches from the floor or wall
- c. vertical railing extended to ramp surface spaced less than 4 inches apart can be used to prevent wheels on wheelchairs and other mobility aids from going off the edge of the ramp.

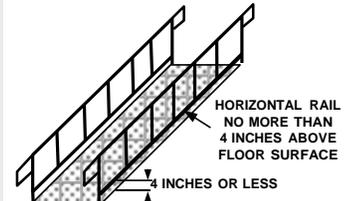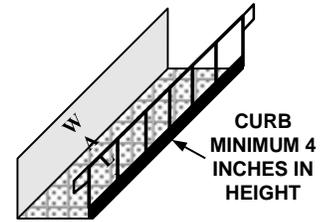

4 INCHES MAXIMUM

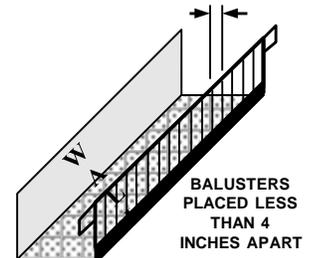


# ACCESSIBLE APPROACH AND ENTRANCE (Exterior Routes)

## 9. Doorway Width and Maneuvering Clearance

Do accessible entrances have a minimum clear opening (free of protrusions and obstructions) of 32 inches?

- Yes
- No

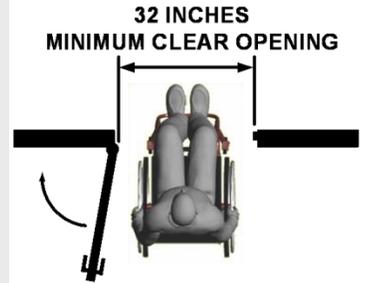


Do the push or pull sides of doors have adequate clearance from the side and front of the doorway to allow customer to reach the handle and maneuver around and through the door opening? See section 404.2.4 of the 2010 ADA Standards for the full requirements.

- Yes
- No


**Note:** If the person using a wheelchair can approach the door from the front, a minimum side distance of 18 inches and a minimum perpendicular distance of 60 inches will suffice if the door swings toward the customer (shown in top figure).

MANEUVERING CLEARANCE AT DOOR  
FRONT APPROACH TO PULL FACE OF DOOR

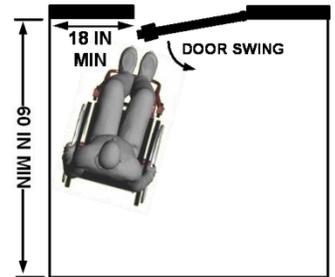

**Note:** A minimum of 12 inches side distance and a minimum perpendicular distance of 48 inches is required for a door that swings away from the customer and has a latch and closer (shown in bottom figure).

MANEUVERING CLEARANCE AT DOOR  
FRONT APPROACH TO PUSH FACE OF DOOR WITH A CLOSER AND LATCH

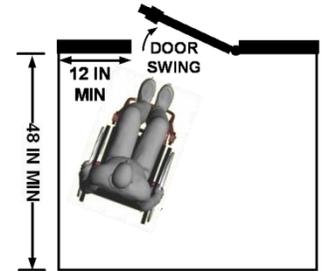

**Note:** Automatic or power assisted doors that remain open in the power-off position do not require these types of maneuvering clearances adjacent to the doors.


**Note:** Where doorways are located adjacent to a ramp landing, maneuvering clearances are permitted to overlap the required ramp landing area.

## 10. Exterior Door Opening Forces

Is the force required to open doors at accessible exterior entrances no more than 10 pounds?

- Yes
- No

**Note:** Exterior door opening forces are not addressed in the ADA Standards. Maximum opening force for an exterior door may be addressed in state building codes. For example, in Washington the maximum force is 10 pounds; in Oregon 8.5 pounds is the maximum exterior door opening force.



# ACCESSIBLE APPROACH AND ENTRANCE (Exterior Routes)


## 11. Door Hardware

Are handles, pulls, latches, locks, and other operating devices on accessible doors easily grasped with one hand, and require no tight grasping, pinching, or twisting of the wrist to operate?


**Note:** Lever and loop handles serve this purpose well.

Are door handles mounted no higher than 48 inches and no lower than 34 inches from the floor surface?

- Yes
- No

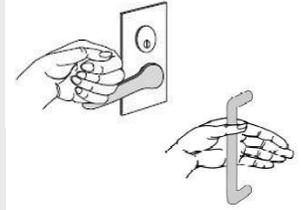

- Yes
- No

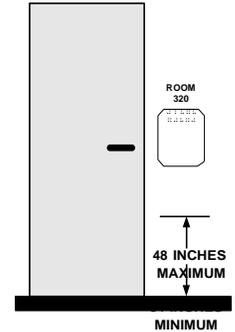


## 12. Doors in Series


If two doors in a series (vestibule) swing in the same direction (see top figure), is the distance between the doors at least 48 inches plus the width of the in-swinging door?

If two doors in series (vestibule) swing out from the space between the doors (see bottom figure), is the distance between the doors at least 48 inches?

- Yes
- No

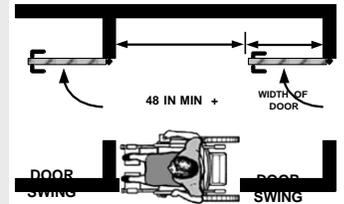

- Yes
- No

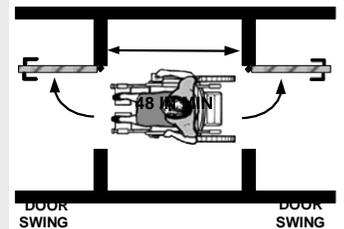


## 13. Thresholds at Doorways


Are the heights of thresholds at doorways 1/2 inch or less?

**Note:** Raised thresholds and level changes at doorways with a height between 1/4 inch and 1/2 inch should be beveled with a maximum slope of 1:2 as shown in the top figure.

- Yes
- No

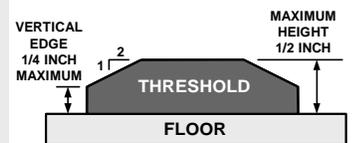

**Note:** Existing or altered thresholds may be 3/4 inch high maximum if their edges are beveled with a slope not steeper than 1:2. See lower figure on the right.

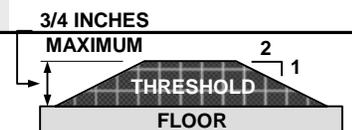

# ACCESSIBLE APPROACH AND ENTRANCE (Exterior Routes)

## 14. Protruding Objects

Do protruding and hanging objects with a leading edge more than 27 inches above the floor, protrude no more than 4 inches into any passage way provided for pedestrian travel?

**Note:** Examples of protruding objects include signs, telephones, water fountains, planters, lamps, fire extinguisher enclosures, etc.


Do all exterior passage ways provide a minimum unobstructed head clearance (headroom) of 80 inches?

Yes

No

Yes

No

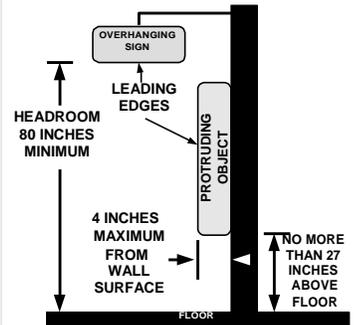


## 15. Suspended Stairs and Other Overhead Hazards

Are all suspended (open) stairs and other overhead hazards provided with sufficient warning devices, for example, guard rails, planters, etc., to alert people who are visually impaired?

Yes

No

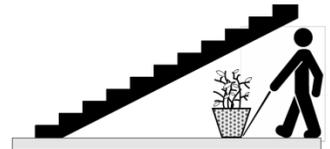


# ACCESS TO GOODS AND SERVICES (Interior Routes and Spaces)

## 1. Doorways

Do the interior doors in public spaces have at least a 32-inch clear, unobstructed opening?

**Note:** With double doors, at least one door must have a minimum clear opening of 32 inches.

- Yes
- No

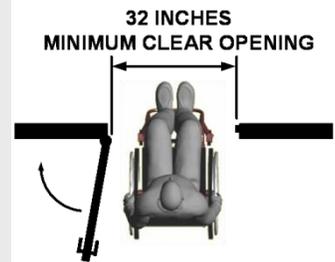

## 2. Maneuvering Clearance

Do the pull and push sides of doors have adequate maneuvering clearances in front of and to the sides of doorways so that a person using a wheelchair can position themselves to easily and safely open the door?

**Note:** See section of this Checklist titled "Accessible Approach and Entrance – Exterior Routes) for more information.

- Yes
- No




## 3. Signs for Permanent Rooms and Spaces

Is every permanent room or space (such as restrooms, offices or meeting rooms, etc.) designated with a sign having good contrast between characters and background, adequate character size for viewing distance, raised (tactile) characters and Braille?

Are tactile signs mounted so the bottom edges of the *highest* tactile characters are 60 inches maximum and the *lowest* tactile characters are 48 inches minimum from the floor surface?


- Yes
- No
  
- Yes
- No

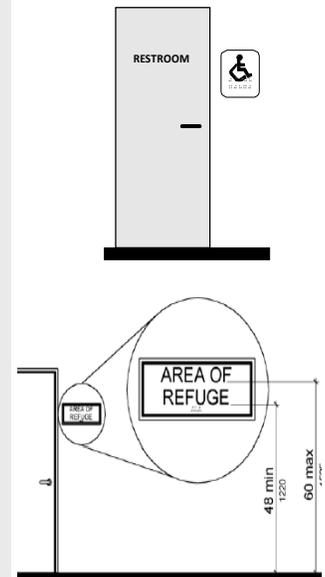

## 4. Opening Force for Interior Doors

Can interior doors be opened with 5 pounds or less force?


- Yes
- No



## 5. Door Handle Height

Are door handles mounted no higher than 48 inches and no lower than 34 inches measured from the floor surface?

- Yes
- No




# ACCESS TO GOODS AND SERVICES (Interior Routes and Spaces)

## 6. Door Hardware

Do all latch doors along an accessible route have a handle that does not require tight grasping, pinching, or twisting to operate?

If there is no latch, do the doors have pulls, loops or push plates?

- Yes
- No
- Yes
- No

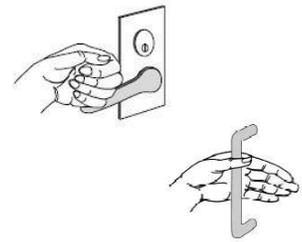


## 7. Thresholds at Doorways

Are the heights of thresholds at doorways 1/2 inch or less?

**Note:** Raised thresholds and level changes at doorways with a height between 1/4 inch and 1/2 inch should be beveled with a maximum slope of 1:2 as shown in the top figure.

**Note:** Existing or altered thresholds may be 3/4 inch high maximum if their edges are beveled with a slope not steeper than 1:2. See lower figure on the right.

- Yes
- No

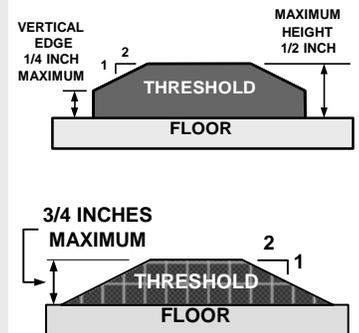


## 8. Clear Width of Accessible Routes and Reach Distances

Do all interior accessible routes have a minimum clear, unobstructed width of 36 inches?

Are all objects meant for public use within reach?

**Note:** For both forward and side reach, the maximum "high" reach height is 48 inches. The minimum "low" distance from the floor surface is 15 inches for forward reach and 10 inches for side reach.

- Yes
- No
- Yes
- No

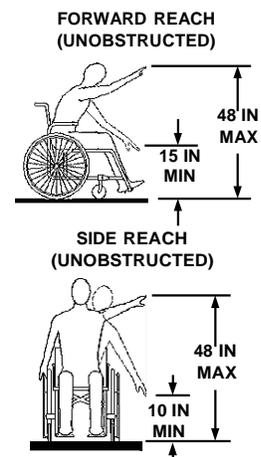


## 9. Turning Space

Is adequate space available where turning spaces are needed or required for a wheelchair or other mobility device?

**Note:** A turning space may be a:

1. **Circular space** having a minimum diameter of 5 feet (60 inches) as shown in top figure, or
2. **T-shaped space** which provides a 60 inch square minimum with arms and base having 36 inches of minimum width.

- Yes
- No

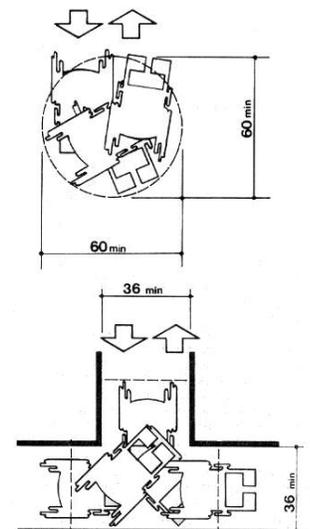


## ACCESS TO GOODS AND SERVICES (Interior Routes and Spaces)

Use items 10-11 on this page to assess tables/work surfaces and seating in most public areas. For tables and seating in dining areas, classrooms or libraries, refer to those sections in this Checklist and fill in the information there.

### 10. Table Placement and Seating Distribution

If tables or work surfaces are available, is there a 36 inch aisle clearance between tables for wheelchair access?


- Yes  
 No

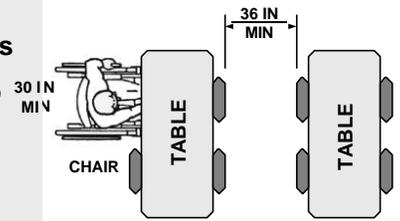

Do seating spaces at tables or work surfaces allow for a forward approach and provide a clear floor space of 30 by 48 inches? See lower figure at right.

- Yes  
 No

MINIMUM CLEAR FLOOR SPACE SEATING AND TABLES

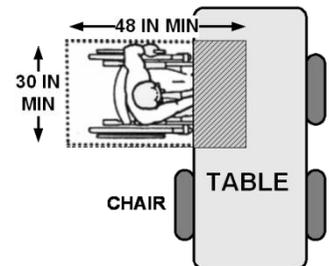

Are accessible tables and accompanying seating spaces distributed throughout the room or space?

- Yes  
 No


**Note:** People should be able to choose the locations and types of tables, seating and other furnishings.

### 11. Table Height and Legroom

Do the spaces under tables or work surfaces provide clear space for knees and toes?

- Yes  
 No

**Note:** 27 inches minimum height under table for knee clearance; 9 inches minimum in height where toe clearance is required; and the clearance for toes shall extend 17 inches minimum under the table?

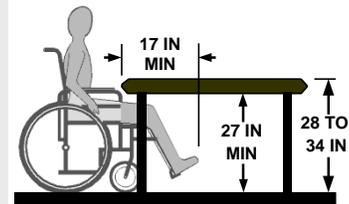

Are top surfaces of the tables and work surfaces 28 inches minimum to 34 inches in maximum height above the floor?


- Yes  
 No

### 12. Protruding Objects

Do protruding and hanging objects with a leading edge more than 27 inches above the floor, protrude no more than 4 inches into any passage way provided for pedestrian travel?

- Yes  
 No

**Note:** Examples of protruding objects include signs, telephones, water fountains, planters, lamps, fire extinguisher enclosures, etc.

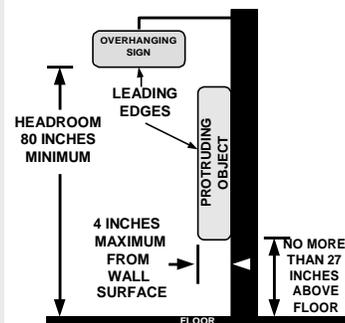



Do all exterior passage ways provide a minimum unobstructed head clearance (headroom) of 80 inches?


- Yes  
 No



# ACCESS TO GOODS AND SERVICES (Interior Routes and Spaces)

<b>IS THERE A RAMP LOCATED ON THE INTERIOR OF YOUR BUILDING?</b>	<input type="checkbox"/> Yes <input type="checkbox"/> No	<b>IF YES, COMPLETE ITEMS #13 TO #17. IF NO, SKIP TO #18.</b>
--	---	---

<b>13. Ramp Slope and Clear Width</b> Is the maximum running slope of all ramps 1:12 (8.3%)?  Are cross slopes of all ramp surfaces 1:48 or less?  Do ramps have a clear unobstructed width of at least 36 inches?	<input type="checkbox"/> Yes <input type="checkbox"/> No  <input type="checkbox"/> Yes <input type="checkbox"/> No  <input type="checkbox"/> Yes <input type="checkbox"/> No	  
---	---	--
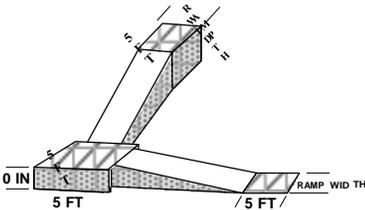
<b>14. Landings</b> Do ramps have a 5 foot long level landing at the top and bottom of each run?  Do ramps have a 5 foot x 5 foot minimum turning space at level landings where the ramp changes direction?  <i>Note: Landings are required where the maximum vertical rise for any length of run for a ramp is 30 inches.</i>	<input type="checkbox"/> Yes <input type="checkbox"/> No  <input type="checkbox"/> Yes <input type="checkbox"/> No	
---	--	---

<b>15. Ramp Handrails</b> If the ramp rises more than 6 inches vertically, does it have handrails on both sides?	<input type="checkbox"/> Yes <input type="checkbox"/> No	
---	---	---
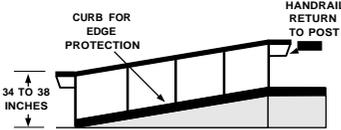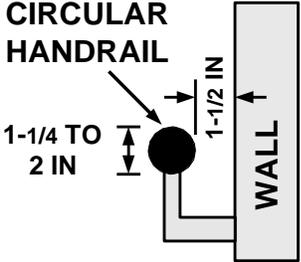
<b>16. Handrail Location</b>  Are handrails mounted so that their top surface is between 34 and 38 inches above the ramp surface?  Do handrails continue to extend horizontally at least 12 inches at the top and bottom landings of the ramp and do these extensions return to the wall, floor or post?  If the handrail is mounted on a wall surface, is the gap between the handrail and the wall surface a minimum of 1-1/2 inches?  If the handrail gripping surface is circular in shape, is the diameter 1-1/4 inches minimum to 2 inches maximum?  If the shape is non-circular, is the perimeter dimension (distance around the gripping surface) 4 inches minimum to 6-1/4 inches maximum?	<input type="checkbox"/> Yes <input type="checkbox"/> No  <input type="checkbox"/> Yes <input type="checkbox"/> No  <input type="checkbox"/> Yes <input type="checkbox"/> No  <input type="checkbox"/> Yes <input type="checkbox"/> No	  
--	--	--

## ACCESS TO GOODS AND SERVICES (Interior Routes and Spaces)

### 17. Edge Protection on Ramps

Do ramps and landings have edge protection?



- Yes  
 No

**Note:** Edge protection can be provided by:


1. By extending the floor surface of a ramp or landing at least 12 inches beyond the railing, or,
2. A curb or barrier edge protection that prevents passage of a crutch tip, a wheel on a wheelchair or other mobility aid from slipping off the edge of the ramp or landing.

Examples are:

- a. curbs at least 4 inches high,
- b. horizontal rails placed no more than 4 inches from the floor or wall
- c. vertical railing extended to ramp surface spaced less than 4 inches apart can be used to prevent wheels on wheelchairs and other mobility aids from going off the edge of the ramp.

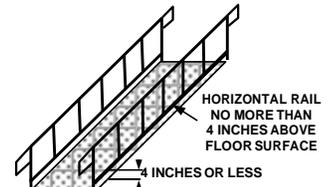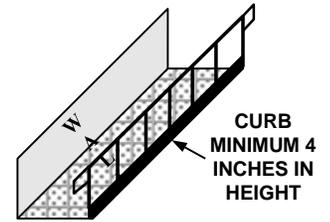

4 INCHES MAXIMUM

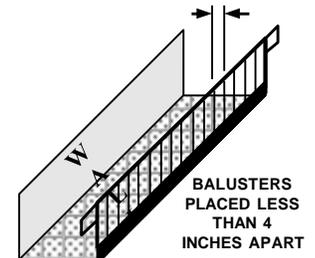

## Priority 3: ACCESS TO GOODS AND SERVICES (Interior Routes and Spaces)


<b>DOES THE FACILITY HAVE A PASSENGER ELEVATOR?</b>	<input type="checkbox"/> Yes	<b>IF NO...</b>
	<input type="checkbox"/> No	<b>SKIP TO #26.</b>

### 18. Hall Call Controls (Buttons) and Entrance Labels

Are call buttons and keypads at elevators mounted no higher than 48 inches when measured to centerline of highest operable part above the floor?

Are there raised (tactile) characters and Braille that indicate floor designations on both elevator jamba at the entrance to elevator mounted 48 to 60 inches above the floor surface?

- Yes  
 No  
 Yes  
 No

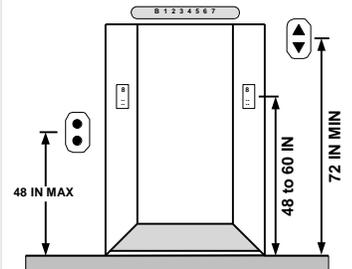


### 19. Signal Identification

Are there both visible and audible signals to identify when an elevator car arrives and its direction of travel?

Are visible signals mounted at 72 inches minimum above floor?

Do the audible signals indicate direction of travel (up or down)? For example, indicator sounds once for up and twice for down.

- Yes  
 No  
 Yes  
 No


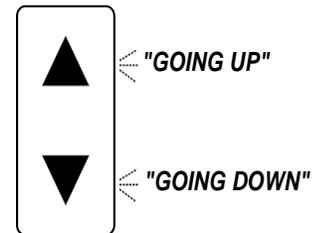


### 20. Elevator Car Dimensions

Do elevators with centered door have minimum inside dimensions of 51 inches in depth by 80 inches in width and a clear door width (unobstructed opening) of 42 inches?

**Note:** Depending on door location, other elevator car dimensions may be allowable. See Table 407.4.1. of the 2010 ADA Standards and figure at bottom right below showing minimum dimensions for an elevator car with a "side (off-centered) door".

- Yes  
 No

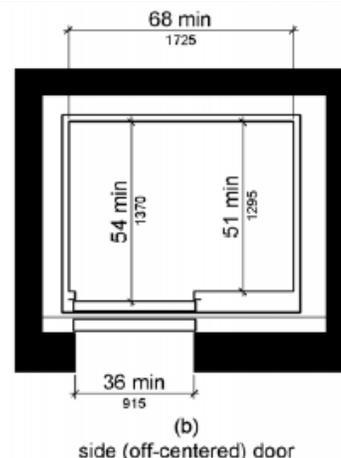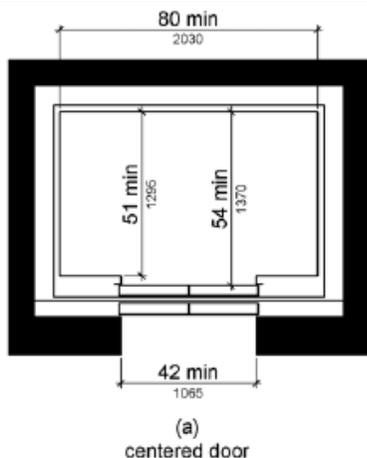


## Priority 3: ACCESS TO GOODS AND SERVICES (Interior Routes and Spaces)

### 21. Leveling

Does the elevator car floor surface (platform) stop within 1/2 inch of the outside floor surface (landing) at each floor destination?


- Yes  
 No

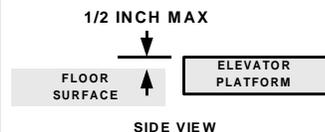

### 22. Gap Between Elevator and Floor

Is the open space between the outside floor surface (hoistway landing) and the elevator platform no greater than 1-1/4 inches?


- Yes  
 No

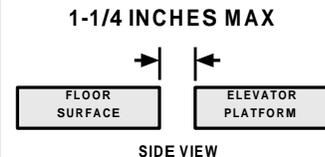

### 23. Protective Re-Opening Device

Are the elevators equipped with reopening devices that automatically opens the car and hoistway doors when it becomes obstructed or contacted by an object or person?

- Yes  
 No



### 24. Car Controls and Position Indicators

Are car controls, call buttons, and alarm buttons at least 3/4 inch in diameter with Braille and raised characters?

**Note:** Raised characters and Braille must be placed to the immediate left of car control buttons.

Are all controls or buttons on the inside of existing elevator control panel mounted no higher than 48 inches above the floor?


- Yes  
 No

Are emergency control buttons mounted at 35 inches minimum height above the floor?

- Yes  
 No

Are visual and audible indicators provided in the interior of the car to indicate car position? (floor/level)

- Yes  
 No

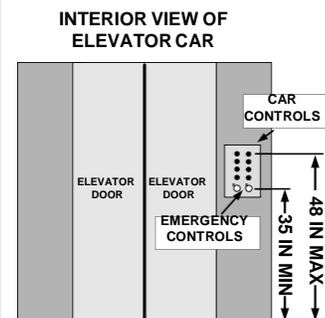

### 25. Emergency Communications

Are emergency two-way communication systems provided between the inside of the elevator and a monitored point outside?

- Yes  
 No

Are emergency control buttons located no higher than 35 inches above the elevator floor and at the bottom of the elevator control panel?

- Yes  
 No

Are tactile symbols (raised characters) provided on or next to the device?

- Yes  
 No



## ACCESS TO GOODS AND SERVICES (Interior Routes and Spaces)

### 26. Drinking Fountains

Where drinking fountains provided, are there two drinking fountains: one wheelchair accessible and one for persons who are standing?

**Note:** One drinking fountain should be designed for access from a seated position (person using a wheelchair). It should be mounted to provide a minimum knee clearance of 27 inches, minimum toe clearance of 9 inches and a minimum depth of 17 inches. The other drinking fountain should be designed for a person who is standing.

**Note:** For an existing installation, where only one drinking fountain is provided, a wheelchair accessible drinking fountain is allowed.

Does the wheelchair accessible drinking fountain provide a minimum knee clearance of 27 inches?


Is there a 30 by 48 inch clear floor space positioned for a forward approach to the wheelchair accessible fountain?

Is the maximum height of the spout outlet for the lower drinking fountain at 36 inches or less above the floor surface?

Can the controls be reached, easily manipulated with one hand, and operated with 5 pounds or less of force?

Yes

No

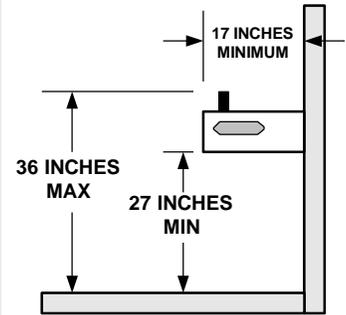

Yes

No

Yes

No

Yes

No

Yes

No

### 27. Automated Teller Machines (ATM)

Where access ATMs are provided:

Is there sufficient clear floor space (30 by 48 inches minimum) adjacent to the ATM to allow for forward or parallel approach by a wheelchair?

Is the maximum height of all operable parts (controls, buttons, deposit slots, etc.) 48 inches from ground surface?

Are operable parts usable with one hand and do not require tight grasping pinching or twisting of the wrist?

Can each operable part be differentiated by sound or touch without activation?

Are operating instructions, transaction prompts and information displayed on the screen of the ATM accessible to persons with visual impairments - "speech-enabled"?

Yes

No

Yes

No

Yes

No

Yes

No

Yes

No



# TOILET ROOMS

**Does your facility offer restrooms for public use?**

Yes     No    *If "Yes", complete this section of the Checklist.*


**Note: M = Men    W = Women**

## 1. Restroom Identification

Are all accessible toilet rooms clearly designated with a sign having the International Symbol of Accessibility and mounted on the latch side of the door so the bottom edge of the *highest* tactile characters are 60 inches maximum and the *lowest* tactile characters are 48 inches minimum from the floor surface?

**Note:** All toilet rooms must be designated with accessible signage and inaccessible toilet rooms must have directional signage indicating the location of the nearest accessible toilet room.


- Yes
- No



## 2. Restroom Entrances

Do the doorways of accessible toilet rooms have a minimum clear width (unobstructed opening) of 32 inches and maneuvering clearance perpendicular and parallel to the doorway which conforms to the requirements of section titled "Accessible Approach and Entrances (Exterior Routes)", Item #9?

- Yes
- No

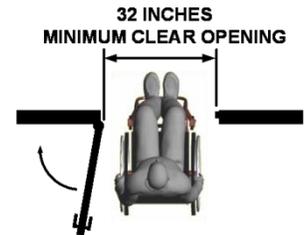


## 3. Turning Space

Is there adequate turning space for a wheelchair or other mobility devices inside the toilet room?

**Note:** A turning space may be circular (60 inches minimum diameter) or a "T turning space". See Item #9 in the section on "Access to Goods and Services—Interior Routes and Spaces".

- Yes
- No



## 4. Lavatory Counter Heights and Knee/Toe Clearances

Is there at least one lavatory that provides a counter surface or rim of the lavatory which is no higher than 34 inches above the floor surface?


Is the knee clearance space under the lavatory at least 27 inches from the bottom of lavatory apron to the floor surface and 8 inches minimum from the front edge of the apron?

Are water supply, drain pipes and other objects installed under the lavatory so that there is at least 9 inches of toe clearance as measured from the floor surface?

- Yes
- No

- Yes
- No

- Yes
- No

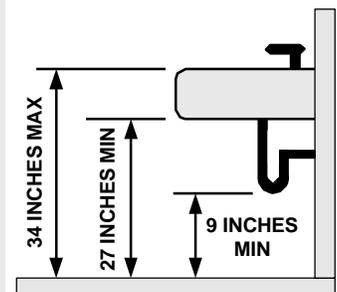


# TOILET ROOMS

## 5. Protective Pipe Covering

Is insulation or other protective covering used on exposed hot water and drain pipes under the lavatories and sinks?

- Yes
- No




## 6. Lavatory and Sink Clear Floor Space

Is there a minimum clear floor space (30 by 48 inches) provided in front of lavatories and sinks to allow for forward approach?

**Note:** Knee clearance shall extend a maximum of 25 inches (of the required minimum of 48 inches of clear floor space) under the lavatory or sink.

Does the depth of toe clearance provided at lavatories and sinks extend at least 17 inches underneath the element?

- Yes
- No
  
- Yes
- No

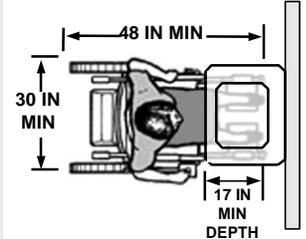


## 7. Faucet Controls

At accessible lavatories and sinks, are the faucets controlled by a hand lever, push button, or electronic control that is easily operated with one hand and not requiring more than 5 lbs. of force or tight grasping, pinching, or twisting?

If the faucet control is hand-operating and metering, does it remain open for a minimum of ten seconds?

- Yes
- No
  
- Yes
- No

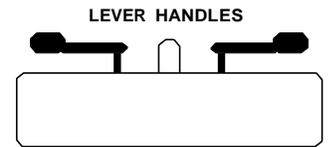


## 8. Lavatory and Countertop Mirrors

Where mirrors are provided above lavatories or countertops, is at least one mirror mounted so that the bottom edge of the reflective surface is no more than 40 inches above the floor surface?

If No, what are the heights? M: \_\_\_\_\_ W: \_\_\_\_\_


- Yes
- No



## 9. Dispensers in Restroom

Are the soap and towel dispensers, and other accessories, mounted at a height no greater than 48 inches to the highest control or operable part?

- Yes
- No




# TOILET ROOMS

## 10. Toilet Seat Height and Distance from Toilet to Wall


Is the top of the toilet seat 17 inches minimum to 19 inches maximum measured from the surface of the floor?

- Yes
- No



Is the centerline of the toilet (water closet) 16 inches minimum to 18 inches maximum from the side wall or partition?

- Yes
- No




**Note:** For ambulatory accessible toilet stalls (see item # 16), the centerline of the toilet (water closet) is 17 inches minimum to 19 inches maximum).

## 11. Grab Bars

Are two grab bars provided that include a 42 inch minimum length bar on the side wall and a 36 inch minimum length bar on the back wall (behind the toilet)?

- Yes
- No

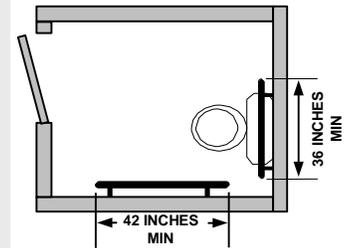

Are grab bars mounted at a height of 33 inches minimum to 36 inches maximum from the floor surface to the top of the gripping surface?


- Yes
- No

Is the space between the walls and grab bars 1-1/2 inches?

- Yes
- No

Is each grab bar mounted securely to the wall or partition?

- Yes
- No

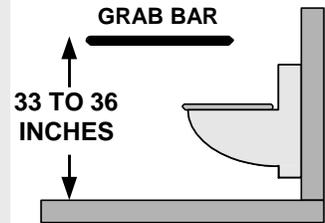


**Note:** Grab bars must be able to support a minimum of 250 pounds.

## 12. Flush Controls

Are hand-operated flush controls located on the open side of the toilet and mounted no higher than 48 inches above the floor?

- Yes
- No

If No, at what height are they mounted?  
M: \_\_\_\_\_ W: \_\_\_\_\_



Are flush controls operable with one hand, not requiring tight grasping, or not more than 5 lbs. of force?

- Yes
- No


## 13. Dispensers in Toilet Stall

If provided, are seat cover dispensers located no higher than 48 inches above the floor surface?

- Yes
- No

Do toilet paper dispensers provide a continuous flow of paper and are they installed at least 15 inches above the floor surface and at a distance between 7 and 9 inches from the front edge of the toilet to the center of the dispenser?

- Yes
- No

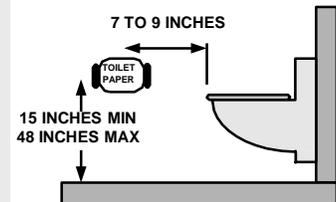

If located above the grab bar, is the dispenser mounted to provide at least 12 inches minimum of space?

- Yes
- No

If located below the grab bar, is the dispenser mounted to provide at least 1-1/2 inches of space?

- Yes
- No

# TOILET ROOMS

*If you have single-user restrooms without a stall, skip to Item 18 for single-user restrooms.*

*If you have multiple- or single-user restrooms with stalls at least one must be accessible and meet the requirements in Items #14 - 16.*

## 14. Toilet Compartment (Stall) Door


Do the accessible stall doors have a clear width of 32 inches and sufficient maneuvering clearance in front of and to the side of the latch?

**Note:** If the approach is to the latch side of the compartment door, clearance between the door side of the compartment and any obstruction shall be 42 inches minimum (see the figure in item #16 below).

Does stall door swing outward?

**Note:** For wheelchair accessible toilet stalls at the end of a row, the door may swing inward as long as sufficient maneuvering space (see next item 15) is provided inside the stall.

- Yes
- No

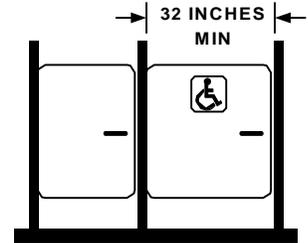


- Yes
- No

## 15. Wheelchair Accessible Toilet Compartment

If toilet stalls are provided, at least one should be wheelchair accessible. Do the wheelchair accessible stalls provide a minimum depth of 56 inches (wall-mounted toilets) or 59 inches (floor-mounted toilets) and a minimum width of 60 inches?

- Yes
- No

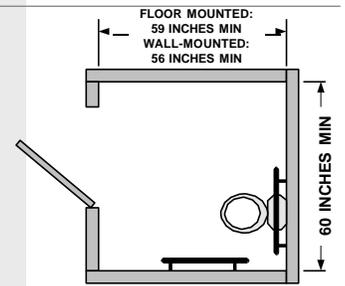

## 16. Ambulatory Accessible Toilet Compartment

Are there 6 or more toilet compartments (stalls) provided in the restroom? (or a combination of urinals and stalls totaling 6 or more?)


If yes, is at least one ambulatory accessible toilet compartment (stall) provided?

Is the ambulatory stall 35 to 37 inches wide and 60 inches minimum in depth?

Are two grab bars provided that are 42 inches long and mounted at 33 to 36 inches above the floor?

Is the space between the wall surface and each grab bar 1-1/2 inches?


- Yes
- No

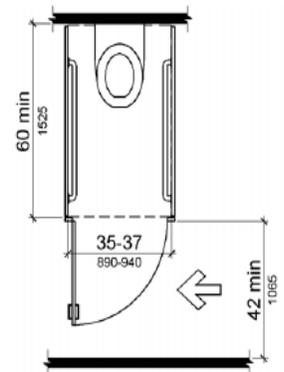

## 17. Urinals

If more than one urinal is provided in the toilet room, is at least one mounted so the rim is no more than 17 inches above the floor and the back of the fixture is a minimum of 13-1/2 inches from the face of the rim?

- Yes
- No



# TOILET ROOMS

## 18. Single- Occupant (“Family” or “Unisex”) Toilet Rooms

**Note:** After answering items #1 through # 13 in this section, the following information may help to identify additional barriers to accessibility in single-occupant toilet rooms.

Does the clearance (floor space) provided around the toilet (water closet) allow for side transfer from a wheelchair? See top figure at right and answer these two questions.

A. 60 inches minimum measured from the side wall?

B. 56 inches minimum measured from the back wall?


**Examples of space use in single-occupant toilet rooms (see figures to the right and below):**

**Top Figure.** Space provided for side transfers and lavatories cannot overlap the toilet (water closet) clearance is indicated. Clearance around a toilet (water closet) must be 60 inches minimum measured perpendicularly from the side wall and 56 inches minimum measured perpendicular from the rear wall.




**Middle Figure.** Turning space can overlap fixture and door swing clearances. Shown is a 60 inch minimum diameter circular turning space which overlaps the clear floor space for the lavatory and the clearance for the water closet..

**Bottom Figure.** Door can swing into turning space as long as unobstructed clear floor space (30 by 48 inches minimum “wheelchair space”) is provided beyond arc of door swing as shown.

Allows space for side transfers

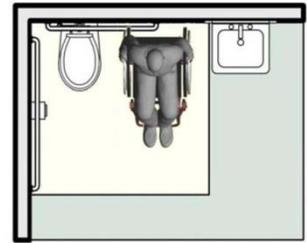

- Yes
- No
- Yes
- No

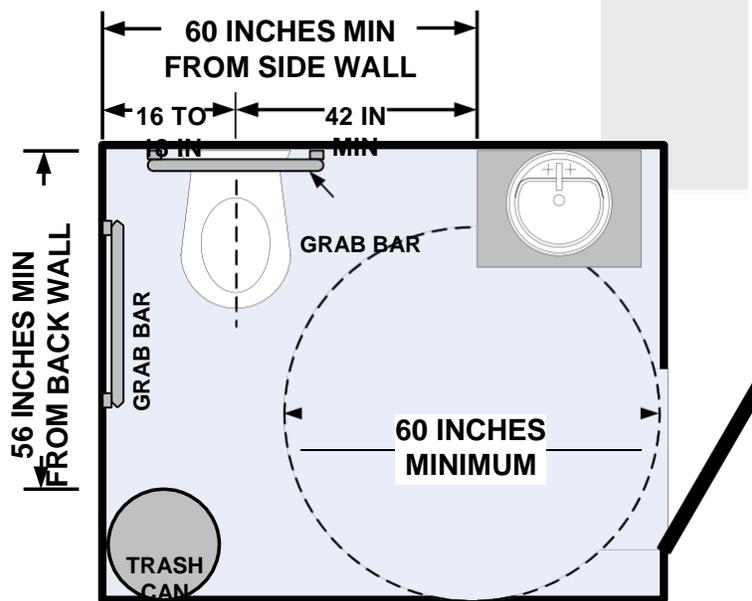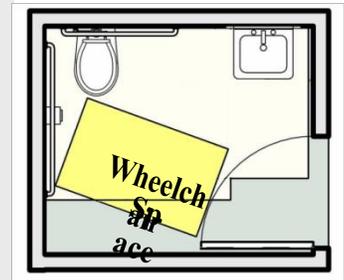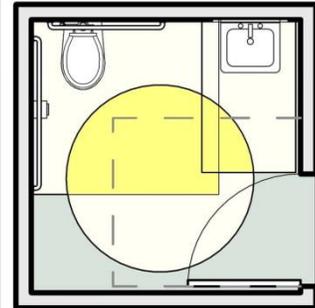

**SINGLE-OCCUPANT**

**TOILET ROOMS**

**TOILET ROOM**

# WAITING ROOMS AND REGISTRATION COUNTERS

## 1. Accessible Routes

Do all interior accessible routes to and through waiting rooms have a minimum clear, unobstructed width of 36 inches?  
 Note: Accessible routes should connect the waiting rooms to all other public and common use areas in the clinic.

- Yes
- No



Are all interior accessible routes to and through waiting rooms free of protruding objects?

- Yes
- No

## 2. Signs in Waiting Rooms

Is directional signage available that indicates the locations of accessible toilet rooms, elevators and other accessible rooms and features of the facility that are not within view?


- Yes
- No



## 3. Wheelchair Seating Spaces in Waiting Room

Is there adequate open floor space available for people who use wheelchairs and other mobility aids?  
**Note:** These spaces should be dispersed within the waiting room and placed adjacent to other seating locations. A minimum width for this space would be 36 inches.


- Yes
- No



## 4. Registration/Service Counters


Does the registration desk allow a parallel approach for a person using a wheelchair or scooter? Note: The accessible portion of the counter surface should be no less than 36 inches in length and have a maximum height of 36 inches above the floor?

- Yes
- No

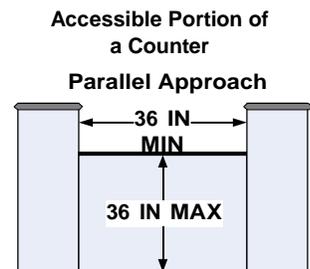

Does the registration desk allow a forward approach for a person using a wheelchair or scooter? **Note:** In this case a portion of the counter must provide a surface which is at least 30 inches in length, no higher than 36 inches high, and have adequate knee and toe clearance underneath.


- Yes
- No



## 5. Literature Display Racks

If literature display racks are available, are they within accessible reach ranges? **Note:** The maximum side and forward reach height is 48 inches; minimum low reach is 15 inches.

- Yes
- No

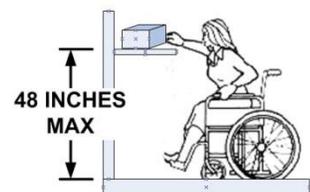

# ACCESSIBLE EXAMINATION ROOMS AND MEDICAL EQUIPMENT

## 1. Accessible Route

Do all interior accessible routes to and through examination rooms have a minimum clear, unobstructed width of 36 inches?  
*Note: Accessible routes should connect the examination rooms to all public use and common use areas.*

Are all interior accessible routes to and through examination rooms free of protruding objects?

- Yes
- No

- Yes
- No




## 2. Signs for Examination Rooms

Is every examination room designated with a sign having good contrast between characters and background, adequate character size for viewing distance, raised (tactile) characters and Braille?

Are tactile signs mounted so the bottom edges of the *highest* tactile characters are 60 inches maximum and the *lowest* tactile characters are 48 inches minimum from the floor surface?

- Yes
- No

- Yes
- No

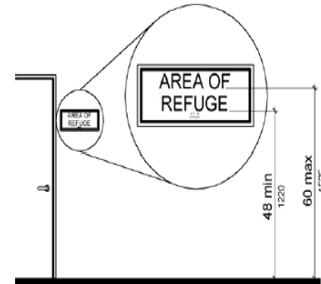

## 3. Accessible Doorway to Examination Room

Do the examination room doors have at least a 32-inch clear, unobstructed opening?

Do the pull and push sides of doors have adequate maneuvering clearances in front of and to the sides of doorways so that a person using a wheelchair can position themselves to easily and safely open the door? **Note:** See section of this Checklist titled "Accessible Approach and Entrance – Exterior Routes) for more information.

Are the heights of thresholds at examination room doorways 1/2 inch or less?


Do examination room doors have a handle that does not require tight grasping, pinching, or twisting to operate (for example, a lever handle) and can the door be opened with 5 pounds or less force?

- Yes
- No


- Yes
- No

- Yes
- No

- Yes
- No



MANEUVERING CLEARANCE AT DOOR  
 FRONT APPROACH TO PULL FACE OF DOOR



## ACCESSIBLE EXAMINATION ROOMS AND MEDICAL EQUIPMENT


### 4. Turning Space Inside the Examination Room

Is adequate space available in the examination room where turning spaces are needed or required for a wheelchair or other mobility device?

- Yes  
 No

**Note:** A turning space may be a:

1. **Circular space** having a minimum diameter of 5 feet (60 inches) as shown in top figure, or
2. **T-shaped space** which provides a 60 inch square minimum with arms and base having 36 inches of minimum width.

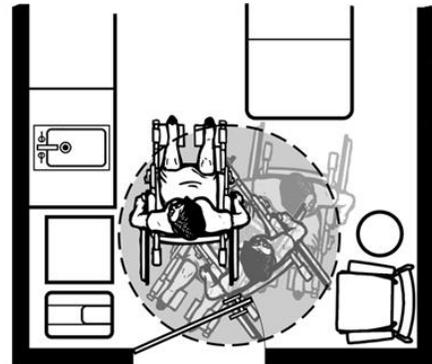



### 5. Clear Floor Space Adjacent to Medical Equipment

Is clear floor space (30 by 48 inches minimum) available adjacent to the exam table or chair and adjoining the accessible route which allows a transfer from a wheelchair?

- Yes  
 No

**Note:** The exam table must have sufficient clear floor space next to it so that an individual using a wheelchair can approach the side of the table for transfer onto it. The minimum amount of space required is 30 inches by 48 inches. Clear floor space is needed along at least one side of an adjustable height examination table. Because some individuals can only transfer from the right or left side, providing clear floor space on both sides of the table allows one accessible table to serve both right and left side transfers. The amount of floor space needed beside and at end of exam table will vary depending on method of patient transfer and lift equipment size.

**Note:** When a portable patient lift or stretcher is to be used, additional clear floor space will be needed to maneuver the lift or stretcher.

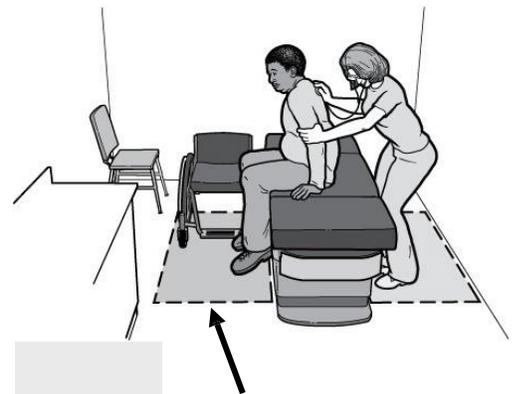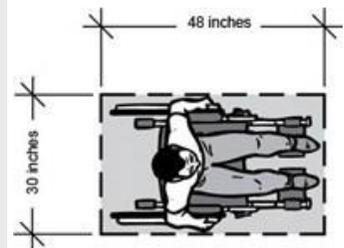

**Clear Floor Space  
Adjacent to**

# ACCESSIBLE EXAMINATION ROOMS AND MEDICAL EQUIPMENT

The U.S. Access Board is developing accessibility standards for medical diagnostic equipment, including examination tables and chairs, weight scales, radiological equipment, and mammography equipment under the “Patient Protection and Affordable Care Act.”

These standards address independent access to, and use of, such equipment by people with disabilities to the maximum extent possible.

Items #6 through 8 below are based on these proposed standards.

United States  
Access Board



## 6. Examination Tables and Chairs

Are examination tables available that provide adjustable transfer heights (range of 17 to 19 inches); adequate dimensions for transfer surface (minimum width of 30 inches and depth of 15 inches; and removable/repositionable support rails to allow wheelchair users to transfer onto and off of the exam table?

Yes

No



If examination chairs are available, does at least one provide adjustable transfer heights (range of 17 to 19 inches); adequate dimensions for transfer surface (minimum width of 21 inches and depth of 15 inches; and fold-up armrests to allow wheelchair users to transfer onto and off of the exam chair?

Yes

No



## 7. Weight Scales

Are accessible weight scales available that can be used to weigh people using wheelchairs and similar types of mobility aids?

Yes

No

**Note:** Accessible scales must have a minimum space for the wheelchair of 36 inches wide by 48 inches in length; access ramps with slopes that do not exceed 1:12 having edge protection with a minimum height of 2 inches; and standing support rails on each side.




## 8. Mammography Equipment

Is accessible mammography equipment available?

Yes

No

**Note:** Accessible mammography equipment should have a breast platform height of 30 inches minimum and 42 inches maximum above floor when used by a patient seated in a wheelchair; a minimum clear floor space of 36 inches wide and 48 inches deep for approach to the equipment; and provide adequate knee and toe clearance under the platform.

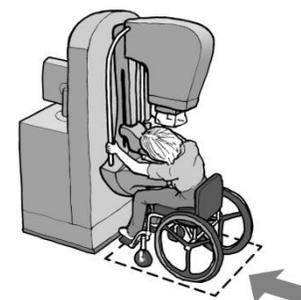

## PATIENT SLEEPING ROOMS

### 1. Number of Accessible Patient Sleeping Rooms (answer one of the three following questions, then proceed to question #2)

If your facility DOES NOT specialize in treating conditions that affect mobility, are there at least 10% (but no fewer than one) patient sleeping rooms that provide the mobility features described in sections 2 through X below?

- Yes  
 No

If your facility specializes in treating conditions that affect mobility, do all patient sleeping rooms provide the mobility features described in sections 2 through X below?

- Yes  
 No

If your facility is a long-term care facility, do a minimum of 50% of rooms provide the mobility features described in sections 2 through X below?

- Yes  
 No


**Note 1.** Conditions that affect mobility include conditions requiring the use or assistance of a brace, cane, crutch, prosthetic device, wheelchair, or powered mobility aid; arthritic, neurological, or orthopedic conditions that severely limit one's ability to walk; respiratory diseases and other conditions which may require the use of portable oxygen; and cardiac conditions that impose significant functional limitations. Facilities that may provide treatment for, but that do not specialize in treatment of such conditions, such as general rehabilitation hospitals, are not considered "as specializing in treatment of conditions that affect mobility".

**Note 2.** Medical care facilities that do not specialize in the treatment of conditions that affect mobility shall disperse the accessible patient bedrooms required by 2010 Standards in a manner that is proportionate by type of medical specialty.

### 2. Bed Spacing

Is there a minimum 30 x 48 inch clear maneuvering space on both sides of the bed(s)?

- Yes  
 No

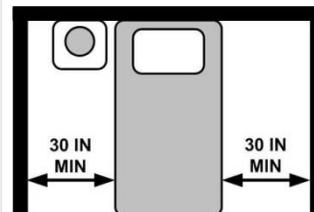

## PATIENT SLEEPING ROOMS

### 3. Turning Space for Wheelchairs

Do accessible patient sleeping rooms allow sufficient turning space for wheelchairs? (See page 12, Item 9 - Turning Space)

- Yes  
 No



### 4. Toilet and Bathing Rooms

Do toilet and bathing rooms that are provided as part of accessible patient or resident sleeping rooms comply with applicable requirements for water closets and lavatories contained in Section 4 - Restrooms of this Checklist or for showers and bath tubs in items 5 through 8 below.

- Yes  
 No

**Note.** Where provided, no fewer than one water closet, one lavatory, and one bathtub or shower shall comply with the applicable requirements for such elements.

### 5. Transfer Shower Stall

Is the floor space in the shower stall at least 36 x 36 inches and is a seat provided?

- Yes  
 No

Is there clear floor space (48 x 36 inches) available at the open side of the shower stall?

- Yes  
 No

Is there an "L-shaped" seat on the wall opposite the shower controls and does it extend the full depth of the stall?

- Yes  
 No

Are horizontal grab bars installed at a height between 33 and 36 inches? See figure for location of bars.


- Yes  
 No

Are controls located at a height between 38 and 48 inches above the floor?

- Yes  
 No

Does the shower spray unit have a flexible hose of at least 60 inches long and can the shower head be used as both a hand-held and fixed unit?

- Yes  
 No

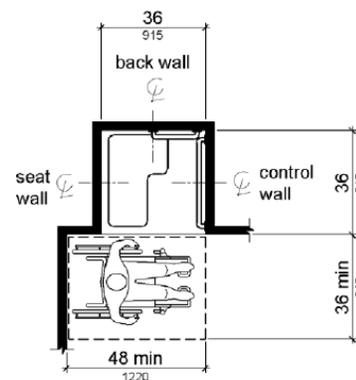

Note: inside finished dimensions measured at the center points of opposing sides

## PATIENT SLEEPING ROOMS

### 6. Roll-In Shower (See figure below)

If a roll-in shower is provided, does it have a minimum clear maneuvering space of 30 x 60 inches inside the shower?

- Yes  
 No

For entry into the shower, is a clear floor space provided which is at least 60 inches in length and 36 inches in width adjacent to the open side?

- Yes  
 No

Is a folding bench located on the side wall adjacent to the shower controls (back wall) and is it 17 minimum to 19 inches maximum above the floor?

- Yes  
 No

Are grabs bars installed parallel to the floor at the height between 33 and 36 inches? See figure for location of grab bars.

- Yes  
 No

Are controls located on the wall adjacent to the shower seat not more than 27 inches from the wall where the seat is mounted and at a height between 38 and 48 inches above the floor?


- Yes  
 No

Does the shower spray unit have a flexible hose of at least 60 inches long and can the shower head be used as both a hand-held and fixed unit?

- Yes  
 No

**Note:** For roll-in showers without seats, the controls can be located on any wall. The 36 wide by 24 inch deep transfer seat with back shown in the picture is a suggested model.

- Yes  
 No

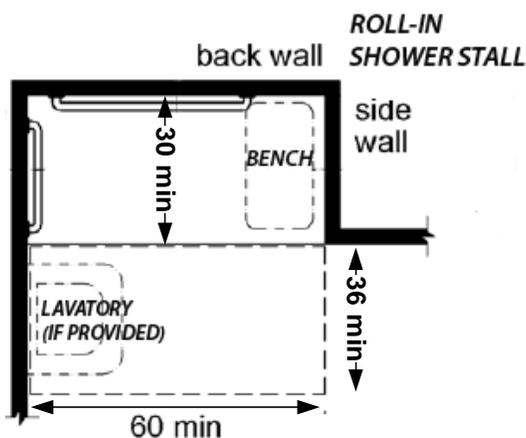


# PATIENT SLEEPING ROOMS

## 7. Grab Bars - Bath Tub with Removable Seat

Are there **four** grab bars of sufficient length and height mounted in the tub? See figure for location of grab bars for a bath tub having a removable seat.


- Yes
- No

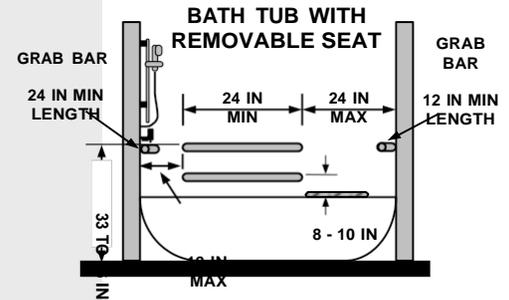

## 8. Grab Bars - Bath Tub with Permanent Seat

Are there **three** grab bars of sufficient length, height and strength mounted in the tub? See figure for location of grab bars for a bath tub having a permanent seat.


- Yes
- No

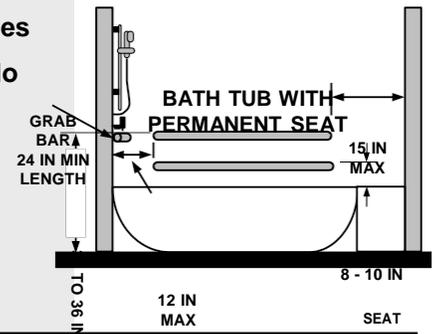

## 9. Light switches, Patient-operated Controls, Storage Units, and Towel Racks

Are light switches, patient-operated controls, storage units, towels racks, dispensers meant for patient use mounted no higher than 48 inches from floor level?

- Yes
- No

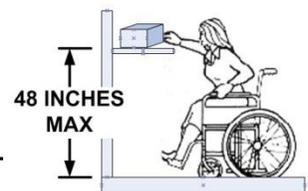

## 10. Entry Doors to Patient Room

Do the doors to patient rooms meet the requirements stated in Section - Items 1, 3, 4, 5, 6 and 7 on pages 11 and 12?

- Yes
- No

**Note:** No maneuvering clearance is required beyond the latch side of the door. (2010 ADA Standards, 404.2.4—Exception)

# SIGNAGE

**Signs provide an important means of communication. Some of the general considerations and requirements for signage are listed here for your reference. As you survey your facility be aware of the need for signage that complies with these general requirements.**

## 1. General Requirements

Is adequate signage placed in standardized, appropriate locations throughout the building or facility?

**Note:** Signs are used to identify permanent rooms or spaces, or provide direction to accessible features and information.

**Note:** Accessible elements and spaces of a facility should be identified by the International Symbol of Accessibility and this requirement is addressed in various sections of this Checklist.

Do the visual characters on all signs have sufficient size for the required viewing distance?

Do characters and background have a non-glare finish?

Do the characters contrast well with the background (either light on dark or dark on light)?

Does the signage identifying permanent rooms or spaces provide both raised (tactile) characters and Braille?

- Yes
- No




- Yes
- No

- Yes
- No

- Yes
- No

- Yes
- No



## 2. Interior Signage Adjacent to Doors

Is every permanent room or space (such as restrooms, offices or classrooms, etc.) designated with a sign having good contrast between characters and background, adequate character size for viewing distance, raised (tactile) characters and Braille?


Are tactile signs mounted so the bottom edges of the *highest* tactile characters are 60 inches maximum and the *lowest* tactile characters are 48 inches minimum from the floor surface?

Are signs mounted on the latch side of doors?

- Yes
- No

- Yes
- No

- Yes
- No

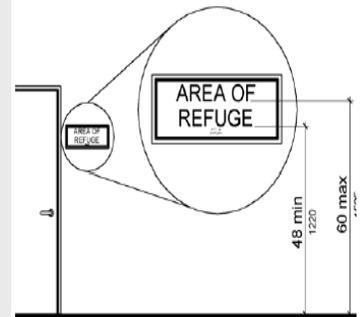

## 3. Directional Signage

Is exterior signage available at non-accessible entrances and along walkways that provides directions to the accessible routes and entrances?

Is interior directional signage provided at inaccessible toilet rooms and elevators directing the person to nearest accessible toilet rooms and elevators?

- Yes
- No

- Yes
- No



## 4. Building Directories and Temporary Signs

These types of signage do not need to comply with the accessibility requirements for signage.

Please use this space for notes or sketches:

A large, empty rectangular box with a thin black border, occupying most of the page. It is intended for the user to write notes or draw sketches.

**BUILDING AND CONTACT INFORMATION**

---

Name of Building or Facility: \_\_\_\_\_

Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Do you know what year this building was constructed? \_\_\_\_\_

Name of persons performing survey with email address and phone number:

\_\_\_\_\_ Signature: \_\_\_\_\_

\_\_\_\_\_ Signature: \_\_\_\_\_

Email: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of completion: \_\_\_\_\_

How long did it take to perform this accessibility survey? \_\_\_\_\_

Do you have suggestions about the survey design or the instructions?

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Do you have comments about the accessibility survey process?

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

---

Reviewed by:

Date:

\_\_\_\_\_

\_\_\_\_\_